

Schletter GmbH

Gewerbegebiet B15
Alustraße 1
D-83527 Kirchdorf/Haag i. OB

Phone: +498072 9191-0

Fax: +498072 9191-9100

info.de@schletter-group.com

<https://www.schletter-group.com/>

Planning documentation for the bearing system
Pitched roof system for solar modules

Project: Mattias_Andersson_36x300Wp_house

Module type: 300 1670 x 1006 mm



By order

Andersson_Mattias

Schletter GmbH Solar Montagesystem

Project planning and auto-calculation

Version 4.15.0.0

Plant details

Date	14/09/2018
Customer	Anderssson_Mattias
Order	
Plant	3 R à 15 Mod

Module selection

Manufacturer	Heckert
Module	300
Peak power	300 W
Height	1,670 mm
Width	1,006 mm
Thickness	38 mm
Framing	Framed

**Module arrangement**


Modules per row	15
Module rows	3
Number of modules	36
Selected support distance	1,200 mm
Cantilever	400 mm
Number of identical module fields	1


Basic configuration

System selection	
Module-bearing rail	Solo
Clamp type	Rapid16
Fastening	Rapid 2+ 45

Results: Plant details

Peak power	10.80 kW
------------	----------

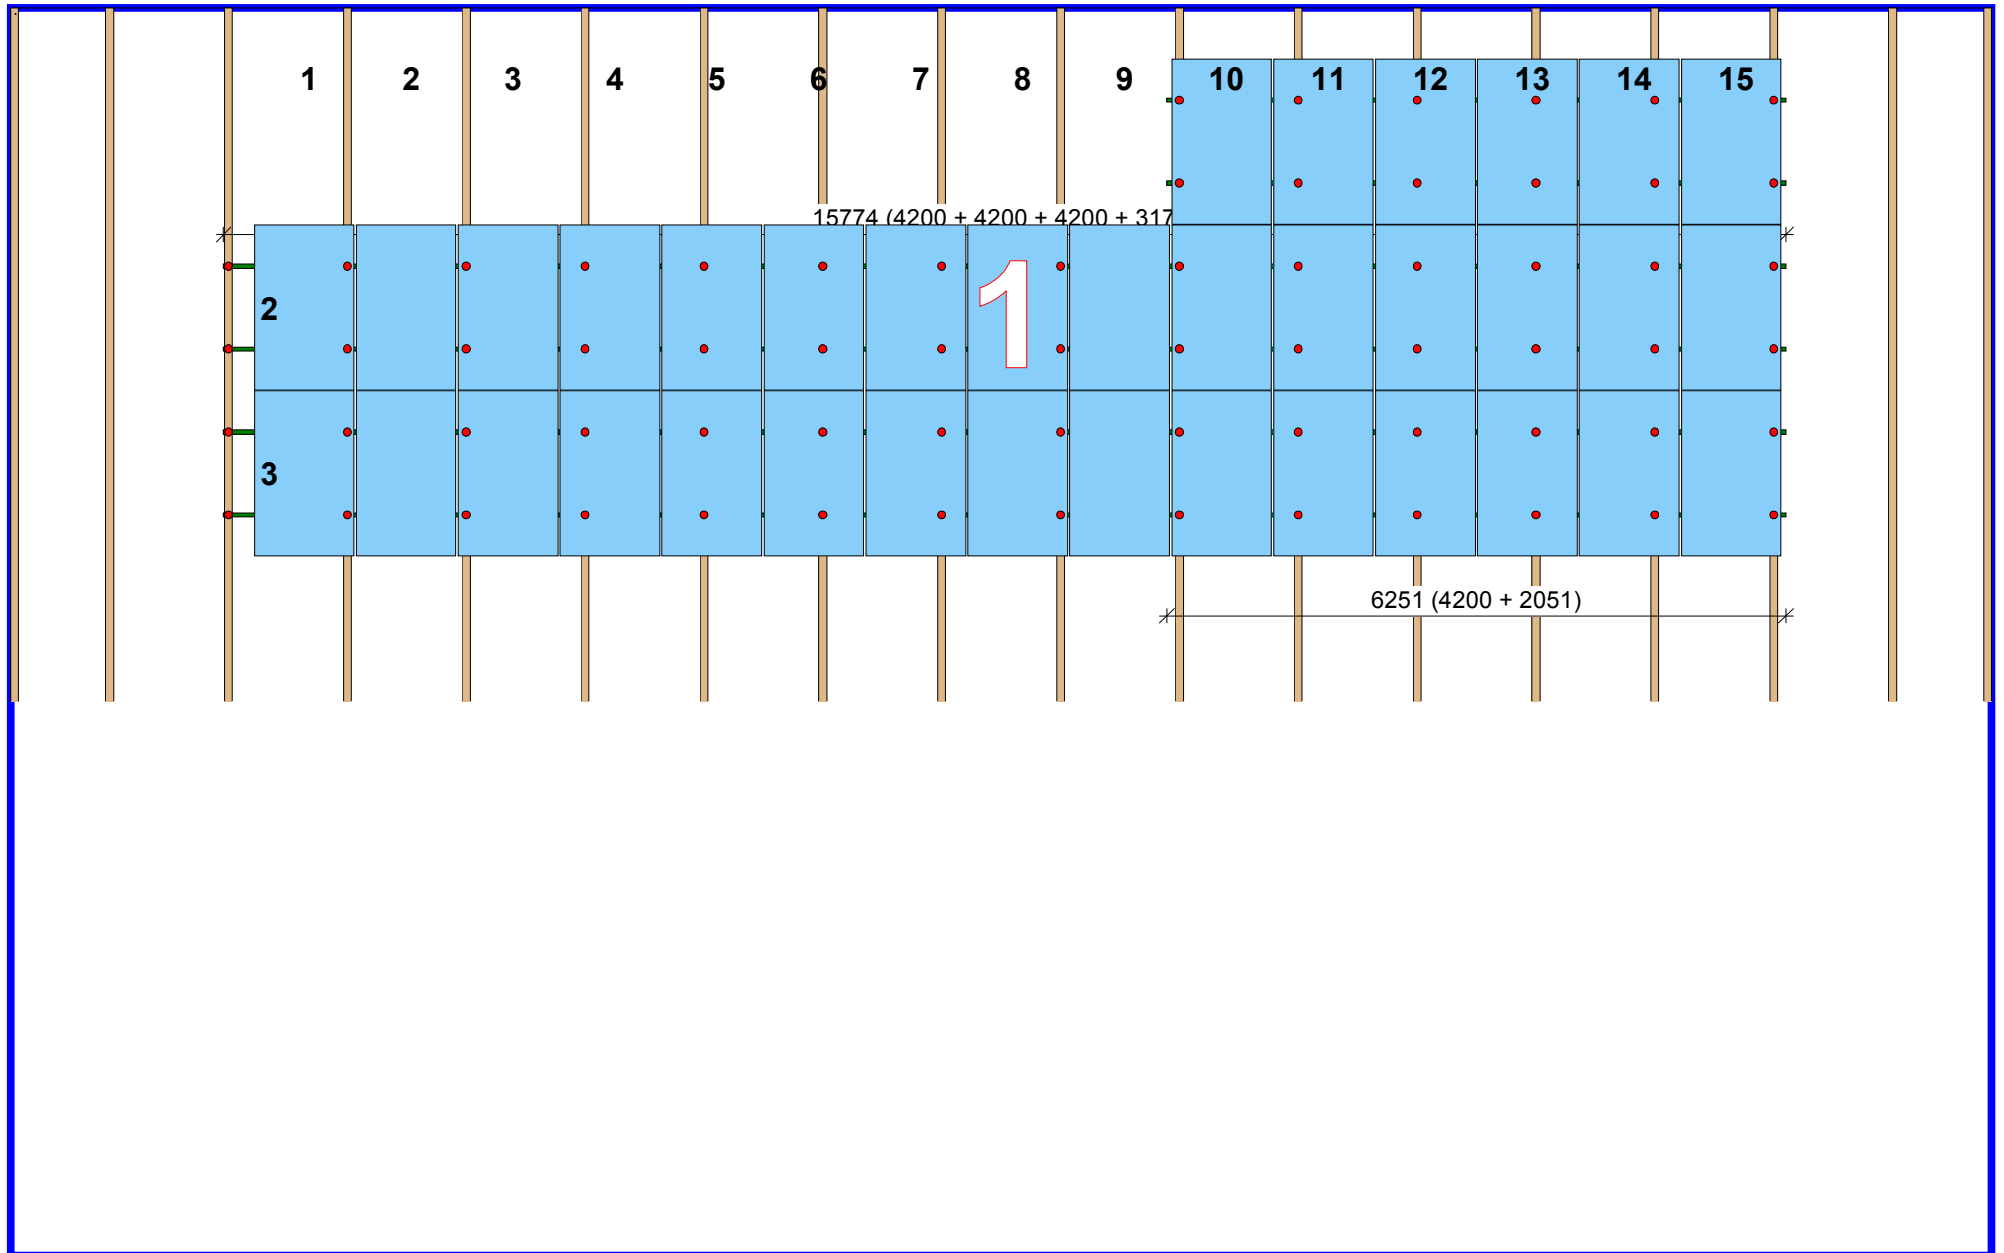

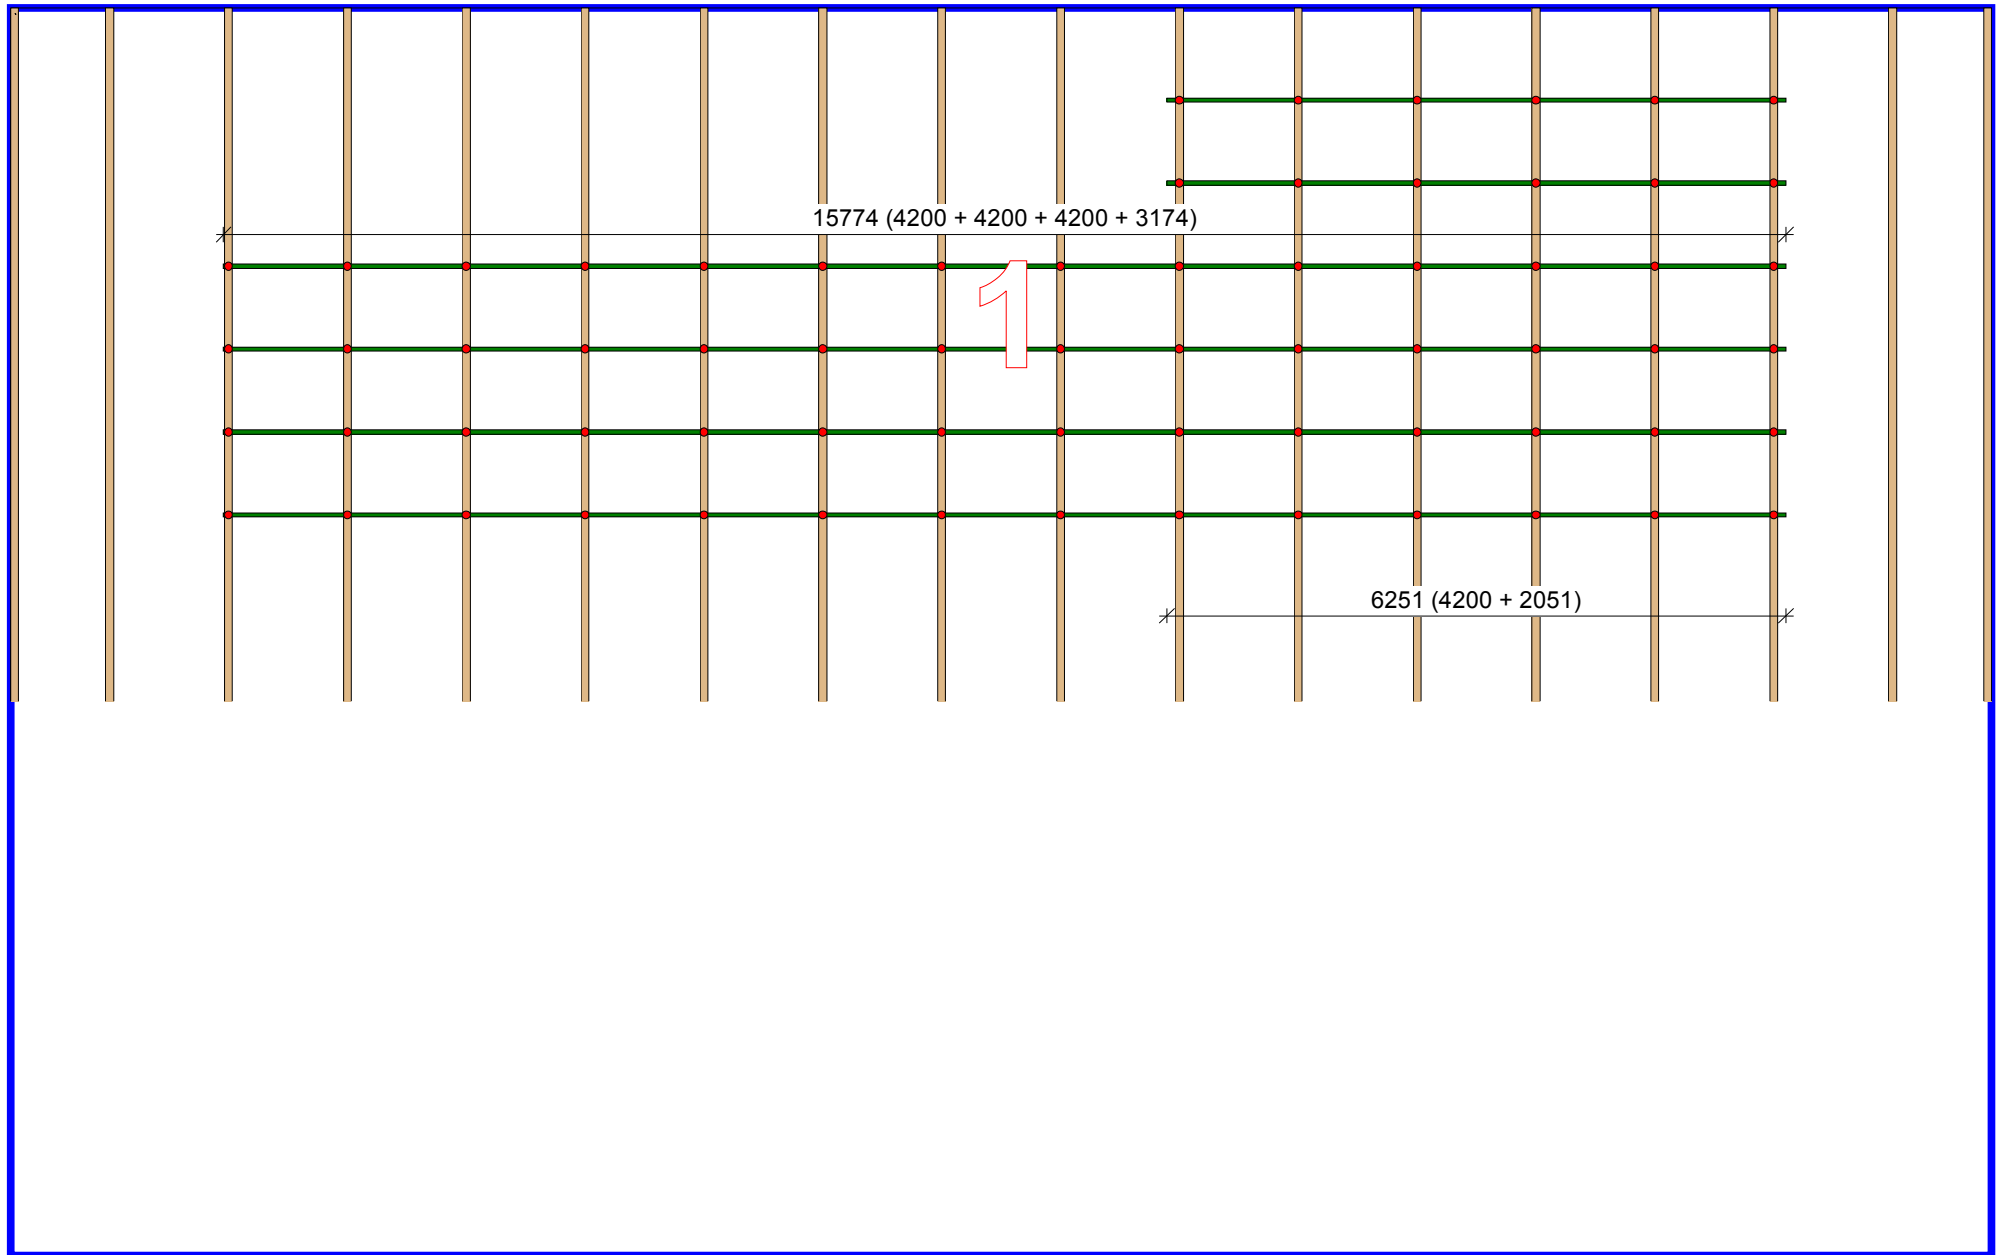


Schletter GmbH Solar Montagesystem

Customer	Anderssson_Mattias
Project	Mattias_Andersson_36x300Wp_house

Bill of Materials: Pitched Roof System 3V

Pos	Item number	Item	Quantity	Length mm	Unit	Weight kg
1	120005-04200	Mod.-bearing rail Solo - 4200mm	19		ST	64.828
2	129060-001	Slide-in connector Solo kit	50 (14)		ST	2.576
3	129011-000	Plastic end cap Solo	100 (12)		ST	0.096
4	101001-000	Roof hook Rapid2+ 45	80 (68)		ST	69.496
5	943208-120	Screw 8x120 TX VA wafer-head wood	150 (136)		ST	3.808
6	131101-001	End clamp Rapid16 30 - 40	50 (12)		ST	0.636
7	131121-001	Middle clamp Rapid16 30 - 40	100 (66)		ST	3.300
8	I400105GB	ID plate Solar Mounting Systems	1			0.100
9	135003-002	Grounding and lightning prot.clamp VAM	20 (6)		ST	0.192
Total						145.032

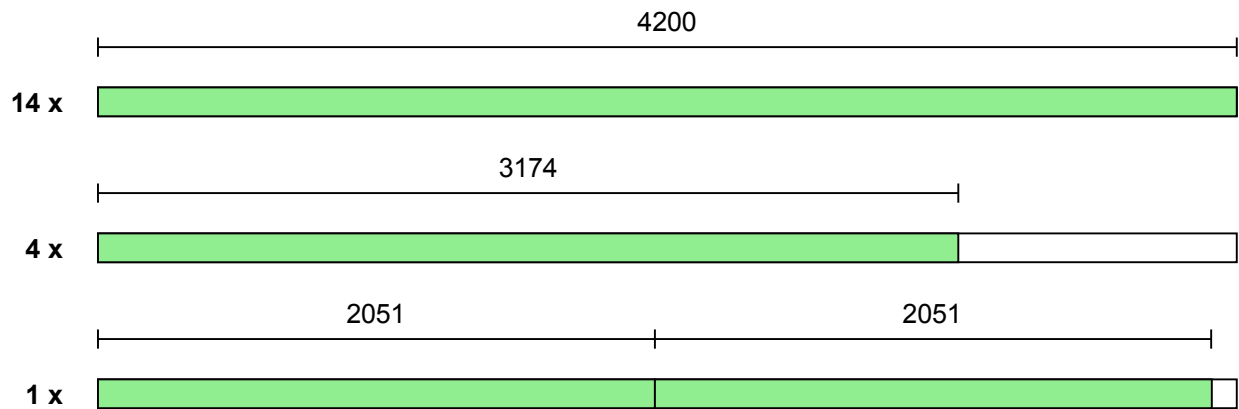Cutting plan (All dimensions in mm)**Module-bearing rail: Solo (120005-04200)**

Preliminary remarks

The following design calculations apply for multi-span mounting systems in midland areas with regular conditions. In coastal areas and exposed locations (with special terrain formation), the consideration of higher wind loads is required. In these cases,

Customer Anderssson_Mattias
 Order
 Postal code construction site **41110 Göteborg**
 57.7072 ° northern latitude
 11.9668 ° eastern longitude

Module-bearing rail


Tilt angle	α	45.0	°
Module height	h	1.67	m
Height above ground	z	4.00	m
Height of roof parapet	h _p	0.00	m
Cantilever module beam	a _{kr}	0.40	m
Span of module beam	a	1.20	m

Structural system


Gable roof (double pitch roof)

Module-bearing rail Solo

Load assumptions acc. to SS EN 1991-1-3 + EKS 8

Load assumptions acc. to	g	0.11	kN/m ²
Snow load	s	0.60	kN/m ²
Terrain category		III	

Gebiete mit gleichmäßiger Vegetation oder Bebauung oder mit einzelnen Objekten mit Abständen von weniger als der 20-fachen Hindernishöhe (z. B. Dörfer, vorstädtische Bebauung, Waldgebiete).

Terrain category III


Peak velocity pressure q **0.41** kN/m²

Equivalent substitute loads

q _k kN/m ²	q _d kN/m ²
0.12	0.17

Verification of module-bearing rails (allowable spans) Solo (120005)

Applicable for Roof mounting Central area

Tilt angle	α	45	°	sin = 0.707	cos = 0.707
Module height	h	1.67	m	$c_{f1} = 0.60$	$c_{f2} = -0.90$
Height above ground	z	4.00	m	Peak velocity pressure 0.41 kN/m ²	
Span	a	1.20	m	Snow load 0.60 kN/m ²	
Cantilever	a_{kr}	0.40	m	Module weight 0.11 kN/m ²	

Load overview

Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind pressure

$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

$$w_{sz} = 0.41 \cdot -0.90 = -0.37 \text{ kN/m}^2$$

$$W_{dz} = 0.25 \cdot 0.84 = 0.20 \text{ kN/m}$$

$$W_{sz} = -0.37 \cdot 0.84 = -0.31 \text{ kN/m}$$

Profile/rail characteristics

$$\text{Overall system area } A = 3.01 \text{ cm}^2$$

$$\text{Section modulus } W_y = 2.79 \text{ cm}^3$$

$$\text{Section modulus } W_z = 2.55 \text{ cm}^3$$

Partial safety factors and combination coefficients

$$\gamma_g = 1.35 \quad \text{Importance/reliability factor}$$

$$\gamma_q = 1.50 \cdot 0.9 = 1.37 \quad K_{FI} = 0.91 \text{ (RC2)}$$

$$\Psi_{0,w} = 0.30$$

$$\Psi_{0,s} = 0.70 \quad \gamma_g = 0.90 \text{ (For favourable action)}$$

Section forces factors for single and multi-span girders

n	$M_{1,total}$	$M_{1,partial}$	$M_{2,total}$	$M_{2,partial}$	$M_{B,total}$	$M_{B,partial}$	A_{total}	$A_{partial}$	B_{total}	$B_{partial}$	Q_{total}	$Q_{partial}$
1	0.125	0.125	0.000	0.000	0.000	0.000	0.500	0.500	0.000	0.000	0.500	0.500
2	0.070	0.096	0.000	0.000	-0.125	-0.125	0.375	0.438	1.250	1.250	0.625	0.625
3	0.080	0.101	0.025	0.075	-0.100	-0.117	0.400	0.450	1.100	1.200	0.600	0.617
4	0.077	0.100	0.036	0.080	-0.107	-0.121	0.393	0.446	1.143	1.223	0.607	0.621

Internal forces vertical

n	Load combination 1				Load combination 2				Load combination 3			
	$M_{z,span}$	$M_{z,supp}$	$M_{z,cant}$	A	$M_{z,span}$	$M_{z,supp}$	$M_{z,cant}$	A	$M_{z,span}$	$M_{z,supp}$	$M_{z,cant}$	A
1	0.092	0.000	-0.002	0.346	0.109	0.000	-0.002	0.409	-0.065	0.000	0.000	-0.245
2	0.067	-0.092	-0.002	0.767	0.080	-0.109	-0.002	0.907	-0.052	0.065	0.000	-0.544
3	0.072	-0.084	-0.002	0.726	0.085	-0.100	-0.002	0.860	-0.054	0.062	0.000	-0.529
4	0.071	-0.087	-0.002	0.742	0.084	-0.104	-0.002	0.879	-0.054	0.064	0.000	-0.538

Internal forces horizontal

n	Load combination 1				Load combination 2				Load combination 3			
	$M_{y,span}$	$M_{y,supp}$	$M_{y,cant}$	A	$M_{y,span}$	$M_{y,supp}$	$M_{y,cant}$	A	$M_{y,span}$	$M_{y,supp}$	$M_{y,cant}$	A
1	0.077	0.000	-0.001	0.289	0.058	0.000	-0.001	0.220	0.010	0.000	0.000	0.039
2	0.056	-0.077	-0.001	0.641	0.042	-0.058	-0.001	0.487	0.006	-0.010	0.000	0.085
3	0.060	-0.070	-0.001	0.605	0.045	-0.053	-0.001	0.457	0.007	-0.008	0.000	0.075
4	0.059	-0.073	-0.001	0.619	0.044	-0.055	-0.001	0.468	0.006	-0.009	0.000	0.078

Summary

n	Midspan stresses				Stresses moments at support				Utilization ratio
	LC1	LC2	LC3	Max	LC1	LC2	LC3	Max	
1	6.315	6.193	-1.939	6.315	0.000	0.000	0.000	0.000	$f_{y,d} = 18.2 \text{ kN/cm}^2$ Single-span girder $\eta = 34.7\%$
2	4.610	4.516	-1.649	4.610	-6.315	-6.193	1.939	6.315	Double-span girder $\eta = 34.7\%$
3	4.908	4.810	-1.696	4.908	-5.754	-5.639	1.919	5.754	3-span girder $\eta = 31.6\%$
4	4.839	4.742	-1.693	4.839	-5.983	-5.865	1.963	5.983	Multi-span girder $\eta = 32.9\%$
Stresses cantilever moment					0.104	0.094	0.023	0.104	Cantilever $\eta = 0.6\%$

Verification of module-bearing rails (allowable spans) Solo (120005)

Applicable for Roof mounting Border zone

Tilt angle	α	45	°	sin = 0.707	cos = 0.707
Module height	h	1.67	m	$c_{f1} = 0.60$	$c_{f2} = -1.40$
Height above ground	z	4.00	m	Peak velocity pressure 0.41 kN/m ²	
Span	a	1.20	m	Snow load 0.60 kN/m ²	
Cantilever	a_{kr}	0.40	m	Module weight 0.11 kN/m ²	

Load overview

Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind pressure

$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

$$w_{sz} = 0.41 \cdot -1.40 = -0.57 \text{ kN/m}^2$$

$$W_{dz} = 0.25 \cdot 0.84 = 0.20 \text{ kN/m}$$

$$W_{sz} = -0.57 \cdot 0.84 = -0.48 \text{ kN/m}$$

Profile/rail characteristics

$$\text{Overall system area } A = 3.01 \text{ cm}^2$$

$$\text{Section modulus } W_y = 2.79 \text{ cm}^3$$

$$\text{Section modulus } W_z = 2.55 \text{ cm}^3$$

Partial safety factors and combination coefficients

$$\gamma_g = 1.35 \quad \text{Importance/reliability factor}$$

$$\gamma_q = 1.50 \cdot 0.9 = 1.37 \quad K_{FI} = 0.91 \text{ (RC2)}$$

$$\Psi_{0,w} = 0.30$$

$$\Psi_{0,s} = 0.70 \quad \gamma_g = 0.90 \text{ (For favourable action)}$$

Section forces factors for single and multi-span girders

n	M _{1,total}	M _{1,partial}	M _{2,total}	M _{2,partial}	M _{B,total}	M _{B,partial}	A _{total}	A _{partial}	B _{total}	B _{partial}	Q _{total}	Q _{partial}
1	0.125	0.125	0.000	0.000	0.000	0.000	0.500	0.500	0.000	0.000	0.500	0.500
2	0.070	0.096	0.000	0.000	-0.125	-0.125	0.375	0.438	1.250	1.250	0.625	0.625
3	0.080	0.101	0.025	0.075	-0.100	-0.117	0.400	0.450	1.100	1.200	0.600	0.617
4	0.077	0.100	0.036	0.080	-0.107	-0.121	0.393	0.446	1.143	1.223	0.607	0.621

Internal forces vertical

n	Load combination 1				Load combination 2				Load combination 3			
	M _{z,span}	M _{z,supp}	M _{z,cant}	A	M _{z,span}	M _{z,supp}	M _{z,cant}	A	M _{z,span}	M _{z,supp}	M _{z,cant}	A
1	0.092	0.000	-0.002	0.346	0.109	0.000	-0.002	0.409	-0.107	0.000	0.001	-0.403
2	0.067	-0.092	-0.002	0.767	0.080	-0.109	-0.002	0.907	-0.084	0.107	0.001	-0.893
3	0.072	-0.084	-0.002	0.726	0.085	-0.100	-0.002	0.860	-0.088	0.102	0.001	-0.864
4	0.071	-0.087	-0.002	0.742	0.084	-0.104	-0.002	0.879	-0.088	0.105	0.001	-0.880

Internal forces horizontal

n	Load combination 1				Load combination 2				Load combination 3			
	M _{y,span}	M _{y,supp}	M _{y,cant}	A	M _{y,span}	M _{y,supp}	M _{y,cant}	A	M _{y,span}	M _{y,supp}	M _{y,cant}	A
1	0.077	0.000	-0.001	0.289	0.058	0.000	-0.001	0.220	0.010	0.000	0.000	0.039
2	0.056	-0.077	-0.001	0.641	0.042	-0.058	-0.001	0.487	0.006	-0.010	0.000	0.085
3	0.060	-0.070	-0.001	0.605	0.045	-0.053	-0.001	0.457	0.007	-0.008	0.000	0.075
4	0.059	-0.073	-0.001	0.619	0.044	-0.055	-0.001	0.468	0.006	-0.009	0.000	0.078

Summary

n	Midspan stresses				Stresses moments at support				Utilization ratio
	LC1	LC2	LC3	Max	LC1	LC2	LC3	Max	
1	6.315	6.193	-3.443	6.315	0.000	0.000	0.000	0.000	$f_{y,d} = 18.2 \text{ kN/cm}^2$ Single-span girder $\eta = 34.7\%$
2	4.610	4.516	-2.805	4.610	-6.315	-6.193	3.443	6.315	Double-span girder $\eta = 34.7\%$
3	4.908	4.810	-2.912	4.908	-5.754	-5.639	3.328	5.754	3-span girder $\eta = 31.6\%$
4	4.839	4.742	-2.896	4.839	-5.983	-5.865	3.419	5.983	Multi-span girder $\eta = 32.9\%$
Stresses cantilever moment					0.104	0.094	0.035	0.104	Cantilever $\eta = 0.6\%$

Verification of module-bearing rails (allowable spans) Solo (120005)

Applicable for Roof mounting Corner zone

Tilt angle	α	45	°	sin = 0.707	cos = 0.707
Module height	h	1.67	m	$c_{f1} = 0.60$	$c_{f2} = -1.10$
Height above ground	z	4.00	m	Peak velocity pressure 0.41 kN/m ²	
Span	a	1.20	m	Snow load 0.60 kN/m ²	
Cantilever	a_{kr}	0.40	m	Module weight 0.11 kN/m ²	

Load overview

Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind pressure

$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

$$w_{sz} = 0.41 \cdot -1.10 = -0.45 \text{ kN/m}^2$$

$$W_{dz} = 0.25 \cdot 0.84 = 0.20 \text{ kN/m}$$

$$W_{sz} = -0.45 \cdot 0.84 = -0.38 \text{ kN/m}$$

Profile/rail characteristics

$$\text{Overall system area } A = 3.01 \text{ cm}^2$$

$$\text{Section modulus } W_y = 2.79 \text{ cm}^3$$

$$\text{Section modulus } W_z = 2.55 \text{ cm}^3$$

Partial safety factors and combination coefficients

$$\gamma_g = 1.35 \quad \text{Importance/reliability factor}$$

$$\gamma_q = 1.50 \cdot 0.9 = 1.37 \quad K_{FI} = 0.91 \text{ (RC2)}$$

$$\Psi_{0,w} = 0.30$$

$$\Psi_{0,s} = 0.70 \quad \gamma_g = 0.90 \text{ (For favourable action)}$$

Section forces factors for single and multi-span girders

n	M _{1,total}	M _{1,partial}	M _{2,total}	M _{2,partial}	M _{B,total}	M _{B,partial}	A _{total}	A _{partial}	B _{total}	B _{partial}	Q _{total}	Q _{partial}
1	0.125	0.125	0.000	0.000	0.000	0.000	0.500	0.500	0.000	0.000	0.500	0.500
2	0.070	0.096	0.000	0.000	-0.125	-0.125	0.375	0.438	1.250	1.250	0.625	0.625
3	0.080	0.101	0.025	0.075	-0.100	-0.117	0.400	0.450	1.100	1.200	0.600	0.617
4	0.077	0.100	0.036	0.080	-0.107	-0.121	0.393	0.446	1.143	1.223	0.607	0.621

Internal forces vertical

n	Load combination 1				Load combination 2				Load combination 3			
	M _{z,span}	M _{z,supp}	M _{z,cant}	A	M _{z,span}	M _{z,supp}	M _{z,cant}	A	M _{z,span}	M _{z,supp}	M _{z,cant}	A
1	0.092	0.000	-0.002	0.346	0.109	0.000	-0.002	0.409	-0.082	0.000	0.001	-0.309
2	0.067	-0.092	-0.002	0.767	0.080	-0.109	-0.002	0.907	-0.065	0.082	0.001	-0.684
3	0.072	-0.084	-0.002	0.726	0.085	-0.100	-0.002	0.860	-0.068	0.078	0.001	-0.663
4	0.071	-0.087	-0.002	0.742	0.084	-0.104	-0.002	0.879	-0.068	0.081	0.001	-0.674

Internal forces horizontal

n	Load combination 1				Load combination 2				Load combination 3			
	M _{y,span}	M _{y,supp}	M _{y,cant}	A	M _{y,span}	M _{y,supp}	M _{y,cant}	A	M _{y,span}	M _{y,supp}	M _{y,cant}	A
1	0.077	0.000	-0.001	0.289	0.058	0.000	-0.001	0.220	0.010	0.000	0.000	0.039
2	0.056	-0.077	-0.001	0.641	0.042	-0.058	-0.001	0.487	0.006	-0.010	0.000	0.085
3	0.060	-0.070	-0.001	0.605	0.045	-0.053	-0.001	0.457	0.007	-0.008	0.000	0.075
4	0.059	-0.073	-0.001	0.619	0.044	-0.055	-0.001	0.468	0.006	-0.009	0.000	0.078

Summary

n	Midspan stresses				Stresses moments at support				Utilization ratio
	LC1	LC2	LC3	Max	LC1	LC2	LC3	Max	
1	6.315	6.193	-2.541	6.315	0.000	0.000	0.000	0.000	$f_{y,d} = 18.2 \text{ kN/cm}^2$ Single-span girder $\eta = 34.7\%$
2	4.610	4.516	-2.111	4.610	-6.315	-6.193	2.541	6.315	Double-span girder $\eta = 34.7\%$
3	4.908	4.810	-2.182	4.908	-5.754	-5.639	2.483	5.754	3-span girder $\eta = 31.6\%$
4	4.839	4.742	-2.174	4.839	-5.983	-5.865	2.546	5.983	Multi-span girder $\eta = 32.9\%$
Stresses cantilever moment					0.104	0.094	0.028	0.104	Cantilever $\eta = 0.6\%$

Roof hooks configurator Status 4.15.0.0
Preliminary remarks

The following design calculations apply for multi-span mounting systems in midland areas with regular conditions. In coastal areas and exposed locations (with special terrain formation), the consideration of higher wind loads is required. In these cases,


Customer Anderssson_Mattias
 Order
 Postal code construction site **41110 Göteborg**
 57.7072 ° northern latitude
 11.9668 ° eastern longitude

Structural system

Gable roof (double pitch roof) Resting on the roof



Load assumptions acc. to SS EN 1991-1-3 + EKS 8

Load assumptions acc. to g **0.11** kN/m²
 Snow load s **0.60** kN/m²
 Peak velocity pressure q **0.41** kN/m²

Required number of roof hooks in the different roof zones


Required number roof hooks (Center)	0.88 Pc(s)
Actually installed	1.12 Pc(s)/m ²
Allowable lateral cantilever akr (Edge / Border zone)	0.66 m
Screwing depth of the wood screws	60 mm
Compaction Border zone	100%
Compaction Corner zone	100%

Vertical
40.6 kg
Horizontal
28.7 kg

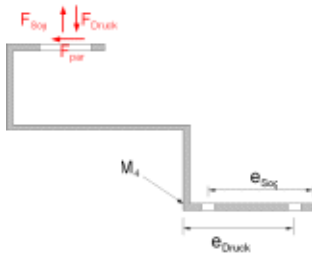

Schletter GmbH Solar Montagesystem

Verification of the roof hook Rapid 2+ 45 (101001-000)

Applicable for Roof mounting on Gable roof (double pitch roof) Central area

Tilt angle	α	45	°	sin = 0.707	cos = 0.707
Snow load	s	0.60	kN/m ²	$c_{p1} = 0.60$	$c_{p2} = -0.90$
Height above ground	z	4.00	m	Peak velocity pressure 0.41 kN/m ²	
Module height	h	1.67		Modular size of substructure 1.20 m	
Module weight	g	0.11	kN/m ²	Cantilever 0.40 m	

Overview load per Square meter Roof area
Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind pressure


$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

Wind suction

$$w_{sz} = 0.41 \cdot -0.90 = -0.37 \text{ kN/m}^2$$

Profile/rail characteristics

Schematic view of profile/rail, indicating the critical sections:

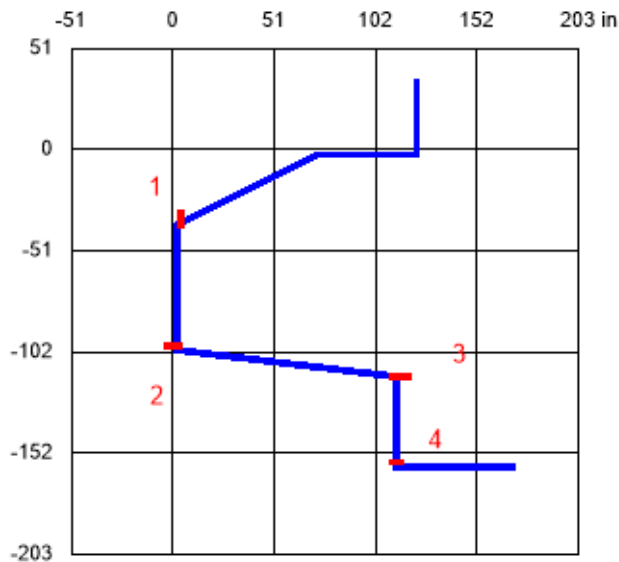

Sheet metal thickness	t = 0.6	cm
Cross-sectional area	A = 2.1	cm ²
Hook width	b = 3.5	cm ²
Section modulus	W = 0.210	cm ³

When determining the loads, the impediment of distortions of the upper leg by the absorbing girder profile is considered. The calculation assumes a partial fixation of 70 %.

Section forces factors for single, double or triple-span girders

n	Force factors			
	A _{total}	A _{partial}	B _{total}	B _{partial}
1	0.500	0.500	0.000	0.000
2	0.375	0.438	1.250	1.250
3	0.400	0.450	1.100	1.200

Load combinations
Load combinations 1: $1.35 \cdot g + 1.365 \cdot s + 0.3 \cdot 1.365 \cdot w$ Load combinations 2: $1.35 \cdot g + 0.7 \cdot 1.365 \cdot s + 1.365 \cdot w$ Load combinations 3: $0.9 \cdot g + 1.365 \cdot w$ Importance/reliability factor: $K_{FI} = 0.91$ (RC2)

n	Load combination 1				Load combination 2				Load combination 3			
	Vertical/portrait		Horizontal/landscape		Vertical/portrait		Horizontal/landscape		Vertical/portrait		Horizontal/landscape	
	A	B	A	B	A	B	A	B	A	B	A	B
1	0.346	0.346	0.289	0.289	0.409	0.409	0.220	0.220	-0.245	-0.245	0.039	0.039
2	0.302	0.767	0.251	0.641	0.358	0.907	0.189	0.487	-0.223	-0.544	0.030	0.085
3	0.310	0.726	0.259	0.605	0.368	0.860	0.195	0.457	-0.227	-0.529	0.032	0.075

Section forces for

Partial fixation due to deformation impediment by cross beams 70%

		Load combination 1		Load combination 2		Load combination 3		Decis. comb.	
		Support A	Support B	Support A	Support B	Support A	Support B	A	B
Section 1	e _{hor} mm	140		140		140		Abs. value	
	e _{vert} mm	86		86		86			
	M kNcm	1.97	4.61	2.59	6.06	1.95	4.54	2.59	6.06
	N kN	-0.26	-0.61	-0.20	-0.46	-0.03	-0.08	-0.26	-0.61
Section 2	e _{hor} mm	140		140		140			
	e _{vert} mm	116		116		125			
	M kNcm	1.21	2.83	2.02	4.71	2.04	4.77	2.04	4.77
	N kN	-0.31	-0.73	-0.37	-0.86	0.23	0.53	-0.31	-0.73
Section 3	e _{hor} mm	-30		-30		-30			
	e _{vert} mm	125		125		125			
	M kNcm	2.45	5.73	2.22	5.19	0.42	0.98	2.45	5.73
	N kN	-0.31	-0.73	-0.37	-0.86	0.23	0.53	-0.31	-0.73
Section 4	e _{hor} mm	-30		-30		-30			
	e _{vert} mm	170		170		170			
	M kNcm	3.61	8.46	3.09	7.24	0.28	0.64	3.61	8.46
	N kN	-0.31	-0.73	-0.37	-0.86	0.23	0.53	-0.31	-0.73
Max. load M =								3.61	8.46
N =								-0.31	-0.73

Stress

$$\sigma = N / A + M / W \quad A = 2.1 \text{ cm}^2 \quad W = 0.21 \text{ cm}^3$$

Except for a possibly existing welded joint in section 4, a plastical reserve of $W_{pl} = 1.25 W_{el}$ can be assumed.

Foot plate, welded Yes

$$R_{p0,2} = 46.00 \text{ kN/cm}^2$$

$$\text{Allowable stress } \text{zul } \sigma = 46.00 \text{ kN/cm}^2$$

(safety factor for components without buckling actions)

Allowable effective load influence zone per hook: $A = \text{zul } \sigma_e / \text{vorh } \sigma$ Required number per m² roof area $n = 1 / A$


	Support A		Support B	
	σ kN/cm ²	n	σ kN/cm ²	n
Section 1	10.00	0.2	23.37	0.5
Section 2	7.93	0.2	18.50	0.4
Section 3	9.48	0.2	22.19	0.5
Section 4	17.36	0.4	40.62	0.9
max n		0.4		0.9

Allowable cantilever $a_{kr} = 0.659 \text{ m}$

(Edge supports have a lower load level due to the multispan action)

Central support 0.9 Roof hooks per 1.00 m²Edge support 0.4 Roof hooks per 0.57 m²Edge support $a = 1.20 \text{ m}$ Module height $a = 1.67 \text{ m}$

t _{erf} mm	Support A	Support B
Section 1	2.6	3.9
Section 2	2.3	3.5
Section 3	2.5	3.8
Section 4	3.7	5.7
max n	3.7	5.7

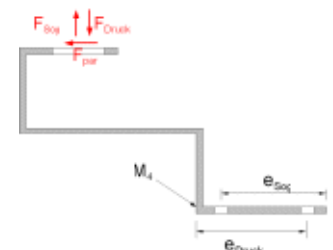

Fastening to the substructure: (acc. to DIN 1052) $e_D = 50 \text{ mm}$ $e_S = 50 \text{ mm}$

Load	Parallel to roof area:	$P_{d,par} / 1.5 = 0.46 \text{ kN}$	$F_{\text{Shearing off}} =$	0.46 kN characteristic
	Pressure:	$M_{4D} = 6.39 \text{ kNcm} \Rightarrow$	$F_{\text{Pressure}} = M_{4D} / e_{\text{Pressure}} =$	1.28 kN characteristic
	Traction:	$M_{4S} = 0.48 \text{ kNcm} \Rightarrow$	$F_{\text{Traction}} = M_{4S} / e_{\text{Traction}} =$	0.20 kN characteristic
Selected	2 Wood screws $\varnothing 8.0 \text{ mm}$			
Shearing off	$zul N_A = n \cdot 1.25 \cdot 17 \cdot d_s^2 \cdot s / (8 \cdot d_s) =$		2.55 kN	
Traction	$zul N_z = n_{\text{Traction}} \cdot 3 \cdot s_g \cdot d_s =$		1.44 kN	
Screwing depth	$s_{min} =$	54 mm		
	$s_{gew} =$	60 mm		
	$s_{max} =$	96 mm		

Schletter GmbH Solar Montagesystem

Verification of the roof hook Rapid 2+ 45 (101001-000)

Applicable for Roof mounting on Gable roof (double pitch roof) Border zone

Tilt angle	α	45	°	sin = 0.707	cos = 0.707
Snow load	s	0.60	kN/m ²	$c_{p1} = 0.60$	$c_{p2} = -1.40$
Height above ground	z	4.00	m	Peak velocity pressure 0.41 kN/m ²	
Module height	h	1.67		Modular size of substructure 1.20 m	
Module weight	g	0.11	kN/m ²	Cantilever 0.40 m	

Overview load per Square meter Roof area
Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind pressure


$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

Wind suction

$$w_{sz} = 0.41 \cdot -1.40 = -0.57 \text{ kN/m}^2$$

Profile/rail characteristics

Schematic view of profile/rail, indicating the critical sections:

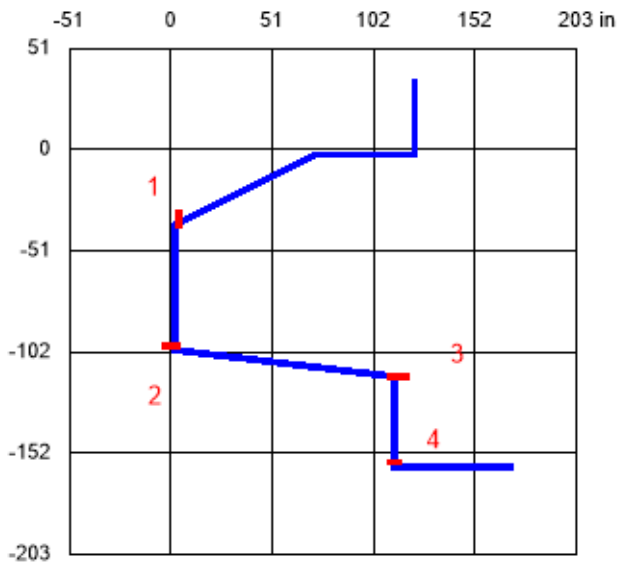

Sheet metal thickness	t = 0.6	cm
Cross-sectional area	A = 2.1	cm ²
Hook width	b = 3.5	cm ²
Section modulus	W = 0.210	cm ³

When determining the loads, the impediment of distortions of the upper leg by the absorbing girder profile is considered. The calculation assumes a partial fixation of 70 %.

Section forces factors for single, double or triple-span girders

n	Force factors			
	A _{total}	A _{partial}	B _{total}	B _{partial}
1	0.500	0.500	0.000	0.000
2	0.375	0.438	1.250	1.250
3	0.400	0.450	1.100	1.200

Load combinations
Load combinations 1: $1.35 \cdot g + 1.365 \cdot s + 0.3 \cdot 1.365 \cdot w$ Load combinations 2: $1.35 \cdot g + 0.7 \cdot 1.365 \cdot s + 1.365 \cdot w$ Load combinations 3: $0.9 \cdot g + 1.365 \cdot w$ Importance/reliability factor: $K_{FI} = 0.91$ (RC2)

n	Load combination 1				Load combination 2				Load combination 3			
	Vertical/portrait		Horizontal/landscape		Vertical/portrait		Horizontal/landscape		Vertical/portrait		Horizontal/landscape	
	A	B	A	B	A	B	A	B	A	B	A	B
1	0.346	0.346	0.289	0.289	0.409	0.409	0.220	0.220	-0.403	-0.403	0.039	0.039
2	0.302	0.767	0.251	0.641	0.358	0.907	0.189	0.487	-0.363	-0.893	0.030	0.085
3	0.310	0.726	0.259	0.605	0.368	0.860	0.195	0.457	-0.371	-0.864	0.032	0.075

Section forces for

Partial fixation due to deformation impediment by cross beams 70%

		Load combination 1		Load combination 2		Load combination 3		Decis. comb.	
		Support A	Support B	Support A	Support B	Support A	Support B	A	B
Section 1	E _{hor} mm	140		140		140		Abs. value	
	E _{vert} mm	86		86		86			
	M kNcm	1.97	4.61	2.59	6.06	3.14	7.32	3.14	7.32
	N kN	-0.26	-0.61	-0.20	-0.46	-0.03	-0.08	-0.26	-0.61
Section 2	E _{hor} mm	140		140		140			
	E _{vert} mm	116		116		125			
	M kNcm	1.21	2.83	2.02	4.71	3.23	7.54	3.23	7.54
	N kN	-0.31	-0.73	-0.37	-0.86	0.37	0.86	-0.31	-0.73
Section 3	E _{hor} mm	-30		-30		-30			
	E _{vert} mm	125		125		125			
	M kNcm	2.45	5.73	2.22	5.19	0.82	1.90	2.45	5.73
	N kN	-0.31	-0.73	-0.37	-0.86	0.37	0.86	-0.31	-0.73
Section 4	E _{hor} mm	-30		-30		-30			
	E _{vert} mm	170		170		170			
	M kNcm	3.61	8.46	3.09	7.24	0.67	1.56	3.61	8.46
	N kN	-0.31	-0.73	-0.37	-0.86	0.37	0.86	-0.31	-0.73
Max. load M =								3.61	8.46
N =								-0.31	-0.73

Stress

$$\sigma = N / A + M / W \quad A = 2.1 \text{ cm}^2 \quad W = 0.21 \text{ cm}^3$$

Except for a possibly existing welded joint in section 4, a plastical reserve of $W_{pl} = 1.25 W_{el}$ can be assumed.

Foot plate, welded Yes

	Support A		Support B	
	σ kN/cm ²	n	σ kN/cm ²	n
Section 1	12.08	0.3	28.17	0.6
Section 2	12.46	0.3	29.07	0.6
Section 3	9.48	0.2	22.19	0.5
Section 4	17.36	0.4	40.62	0.9
max n		0.4		0.9

$$R_{p0,2} = 46.00 \text{ kN/cm}^2$$

$$\text{Allowable stress } \text{zul } \sigma = 46.00 \text{ kN/cm}^2$$

(safety factor for components without buckling actions)

Allowable effective load influence zone per hook: $A = \text{zul } \sigma_e / \text{vorh } \sigma$

Required number per m² roof area $n = 1 / A$

$$\text{Allowable cantilever } a_{kr} = 0.659 \text{ m}$$

(Edge supports have a lower load level due to the multispan action)


Central support 0.9 Roof hooks per 1.00 m²

Edge support 0.4 Roof hooks per 0.57 m²

Edge support a = 1.20 m

Module height a = 1.67 m

t _{erf} mm	Support A	Support B
Section 1	2.8	4.3
Section 2	2.9	4.4
Section 3	2.5	3.8
Section 4	3.7	5.7
max n	3.7	5.7



Fastening to the substructure: (acc. to DIN 1052) $e_D = 50 \text{ mm}$ $e_S = 50 \text{ mm}$

Load	Parallel to roof area:	$P_{d,par} / 1.5 = 0.46 \text{ kN}$	$F_{\text{Shearing off}} =$	0.46 kN characteristic
	Pressure:	$M_{4D} = 6.39 \text{ kNcm} \Rightarrow$	$F_{\text{Pressure}} = M_{4D} / e_{\text{Pressure}} =$	1.28 kN characteristic
	Traction:	$M_{4S} = 1.18 \text{ kNcm} \Rightarrow$	$F_{\text{Traction}} = M_{4S} / e_{\text{Traction}} =$	0.41 kN characteristic
Selected	2 Wood screws $\varnothing 8.0 \text{ mm}$			
Shearing off	$zul N_A = n \cdot 1.25 \cdot 17 \cdot d_s^2 \cdot s / (8 \cdot d_s) =$		2.55 kN	
Traction	$zul N_z = n_{\text{Traction}} \cdot 3 \cdot s_g \cdot d_s =$		1.44 kN	
Screwing depth	$s_{min} =$	54 mm		
	$s_{gew} =$	60 mm		
	$s_{max} =$	96 mm		

Verification of the roof hook Rapid 2+ 45 (101001-000)

Applicable for Roof mounting on Gable roof (double pitch roof) Corner zone

Tilt angle	α	45	°	sin = 0.707	cos = 0.707
Snow load	s	0.60	kN/m ²	$c_{p1} = 0.60$	$c_{p2} = -1.10$
Height above ground	z	4.00	m	Peak velocity pressure 0.41 kN/m ²	
Module height	h	1.67		Modular size of substructure 1.20 m	
Module weight	g	0.11	kN/m ²	Cantilever 0.40 m	

Overview load per Square meter Roof area
Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind pressure


$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

Wind suction

$$w_{sz} = 0.41 \cdot -1.10 = -0.45 \text{ kN/m}^2$$

Profile/rail characteristics

Schematic view of profile/rail, indicating the critical sections:

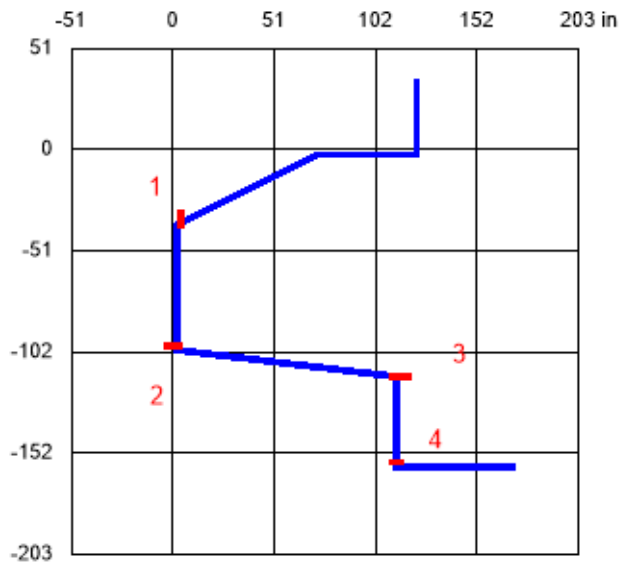

Sheet metal thickness	t = 0.6	cm
Cross-sectional area	A = 2.1	cm ²
Hook width	b = 3.5	cm ²
Section modulus	W = 0.210	cm ³

When determining the loads, the impediment of distortions of the upper leg by the absorbing girder profile is considered. The calculation assumes a partial fixation of 70 %.

Section forces factors for single, double or triple-span girders

n	Force factors			
	A _{total}	A _{partial}	B _{total}	B _{partial}
1	0.500	0.500	0.000	0.000
2	0.375	0.438	1.250	1.250
3	0.400	0.450	1.100	1.200

Load combinations
Load combinations 1: $1.35 \cdot g + 1.365 \cdot s + 0.3 \cdot 1.365 \cdot w$ Load combinations 2: $1.35 \cdot g + 0.7 \cdot 1.365 \cdot s + 1.365 \cdot w$ Load combinations 3: $0.9 \cdot g + 1.365 \cdot w$ Importance/reliability factor: $K_{FI} = 0.91$ (RC2)

n	Load combination 1				Load combination 2				Load combination 3			
	Vertical/portrait		Horizontal/landscape		Vertical/portrait		Horizontal/landscape		Vertical/portrait		Horizontal/landscape	
	A	B	A	B	A	B	A	B	A	B	A	B
1	0.346	0.346	0.289	0.289	0.409	0.409	0.220	0.220	-0.309	-0.309	0.039	0.039
2	0.302	0.767	0.251	0.641	0.358	0.907	0.189	0.487	-0.279	-0.684	0.030	0.085
3	0.310	0.726	0.259	0.605	0.368	0.860	0.195	0.457	-0.285	-0.663	0.032	0.075

Section forces for

Partial fixation due to deformation impediment by cross beams 70%

		Load combination 1		Load combination 2		Load combination 3		Decis. comb.	
		Support A	Support B	Support A	Support B	Support A	Support B	A	B
Section 1	e _{hor} mm	140		140		140		Abs. value	
	e _{vert} mm	86		86		86			
	M kNcm	1.97	4.61	2.59	6.06	2.43	5.65	2.59	6.06
	N kN	-0.26	-0.61	-0.20	-0.46	-0.03	-0.08	-0.26	-0.61
Section 2	e _{hor} mm	140		140		140			
	e _{vert} mm	116		116		125			
	M kNcm	1.21	2.83	2.02	4.71	2.52	5.88	2.52	5.88
	N kN	-0.31	-0.73	-0.37	-0.86	0.28	0.66	-0.31	-0.73
Section 3	e _{hor} mm	-30		-30		-30			
	e _{vert} mm	125		125		125			
	M kNcm	2.45	5.73	2.22	5.19	0.58	1.35	2.45	5.73
	N kN	-0.31	-0.73	-0.37	-0.86	0.28	0.66	-0.31	-0.73
Section 4	e _{hor} mm	-30		-30		-30			
	e _{vert} mm	170		170		170			
	M kNcm	3.61	8.46	3.09	7.24	0.44	1.01	3.61	8.46
	N kN	-0.31	-0.73	-0.37	-0.86	0.28	0.66	-0.31	-0.73
Max. load M =								3.61	8.46
N =								-0.31	-0.73

Stress

$$\sigma = N / A + M / W \quad A = 2.1 \text{ cm}^2 \quad W = 0.21 \text{ cm}^3$$

Except for a possibly existing welded joint in section 4, a plastical reserve of $W_{pl} = 1.25 W_{el}$ can be assumed.

Foot plate, welded Yes

	Support A		Support B	
	σ kN/cm ²	n	σ kN/cm ²	n
Section 1	10.00	0.2	23.37	0.5
Section 2	9.74	0.2	22.73	0.5
Section 3	9.48	0.2	22.19	0.5
Section 4	17.36	0.4	40.62	0.9
max n		0.4		0.9

$$R_{p0,2} = 46.00 \text{ kN/cm}^2$$

$$\text{Allowable stress } \text{zul } \sigma = 46.00 \text{ kN/cm}^2$$

(safety factor for components without buckling actions)

Allowable effective load influence zone per hook: $A = \text{zul } \sigma_e / \text{vorh } \sigma$

Required number per m² roof area $n = 1 / A$

$$\text{Allowable cantilever } a_{kr} = 0.659 \text{ m}$$

(Edge supports have a lower load level due to the multispan action)


Central support 0.9 Roof hooks per 1.00 m²

Edge support 0.4 Roof hooks per 0.57 m²

Edge support a = 1.20 m

Module height a = 1.67 m

t _{erf} mm	Support A	Support B
Section 1	2.6	3.9
Section 2	2.5	3.9
Section 3	2.5	3.8
Section 4	3.7	5.7
max n	3.7	5.7



Fastening to the substructure: (acc. to DIN 1052) $e_D = 50 \text{ mm}$ $e_S = 50 \text{ mm}$

Load	Parallel to roof area:	$P_{d,par} / 1.5 = 0.46 \text{ kN}$	$F_{\text{Shearing off}} =$	0.46 kN characteristic
	Pressure:	$M_{4D} = 6.39 \text{ kNcm} \Rightarrow$	$F_{\text{Pressure}} = M_{4D} / e_{\text{Pressure}} =$	1.28 kN characteristic
	Traction:	$M_{4S} = 0.76 \text{ kNcm} \Rightarrow$	$F_{\text{Traction}} = M_{4S} / e_{\text{Traction}} =$	0.28 kN characteristic
Selected	2 Wood screws $\varnothing 8.0 \text{ mm}$			
Shearing off	$zul N_A = n \cdot 1.25 \cdot 17 \cdot d_s^2 \cdot s / (8 \cdot d_s) =$		2.55 kN	
Traction	$zul N_z = n_{\text{Traction}} \cdot 3 \cdot s_g \cdot d_s =$		1.44 kN	
Screwing depth	$s_{min} =$	54 mm		
	$s_{gew} =$	60 mm		
	$s_{max} =$	96 mm		

Verification of connections

Tilt angle	α	45	°	sin = 0.707		cos = 0.707		
Snow load	s	0.60	kN/m ²	Peak velocity pressure				0.41 kN/m ²
Height above ground	z	4.00	m	Zone F	$C_{p,1} = -1.50$			
Module height	h	1.67		Zone G	$C_{p,1} = -2.00$	Pressure coefficients $C_{pe,1}$		
Module weight	g	0.11	kN/m ²	Zone H	$C_{p,1} = -1.20$			

Load overview

Dead load Modules

$$g_v = 0.11 \cdot 1.00 \cdot 1.00 = 0.11 \text{ kN/m}^2$$

$$g_z = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

$$g_y = 0.11 \cdot 0.707 = 0.08 \text{ kN/m}^2$$

Snow load

$$s_v = 0.60 \cdot 1.00 \cdot 0.707 = 0.42 \text{ kN/m}^2$$

$$s_z = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

$$s_y = 0.42 \cdot 0.707 = 0.30 \text{ kN/m}^2$$

Wind suction

$$w_{dz} = 0.41 \cdot 0.60 = 0.25 \text{ kN/m}^2$$

$$w_{sz} = 0.41 \cdot C_{p,1}$$

Module clamps according to general technical approval Z-14.4-631

Middle clamps		End clamps	
$F_{R,d}$ kN	$V_{R,d}$ kN	$F_{R,d}$ kN	$V_{R,d}$ kN
4.63	0.67	1.63	0.45

Module surface $A = 1.68 \text{ m}^2$
 Frictional connection $A = 0.14 \text{ kN } (F_{S,d} \cdot \mu)$

Internal forces at module clamps

	$V_{S,d}$ kN	$F_{S,d}$ kN		
		Zone F	Zone G	Zone H
Middle clamps	0.29	0.62	0.85	0.48
End clamps	0.14	0.31	0.43	0.24

$$V_{S,d} = V_{S,dy} - F_{S,dz} \cdot \mu \quad (\mu = 0.50)$$

Utilization ratio 43.2%
 Utilization ratio 31.7%

Screwed connections in accordance with general technical approval Z-14.4-639 Appendix 7

$$Z_{Rd} = 5.10 \text{ kN}$$

$$V_{Rd} = 2.00 \text{ kN}$$

Rated value of acting forces

	kN	LC1	LC2	LC3			η %
				Zone F	Zone G	Zone H	
Vertical forces	N_{Sd}			-0.54	-0.88	-0.67	10.5
Shear forces	V_{Sd}	0.62	0.47	0.08	0.08	0.08	30.9